


SC

SASBCU

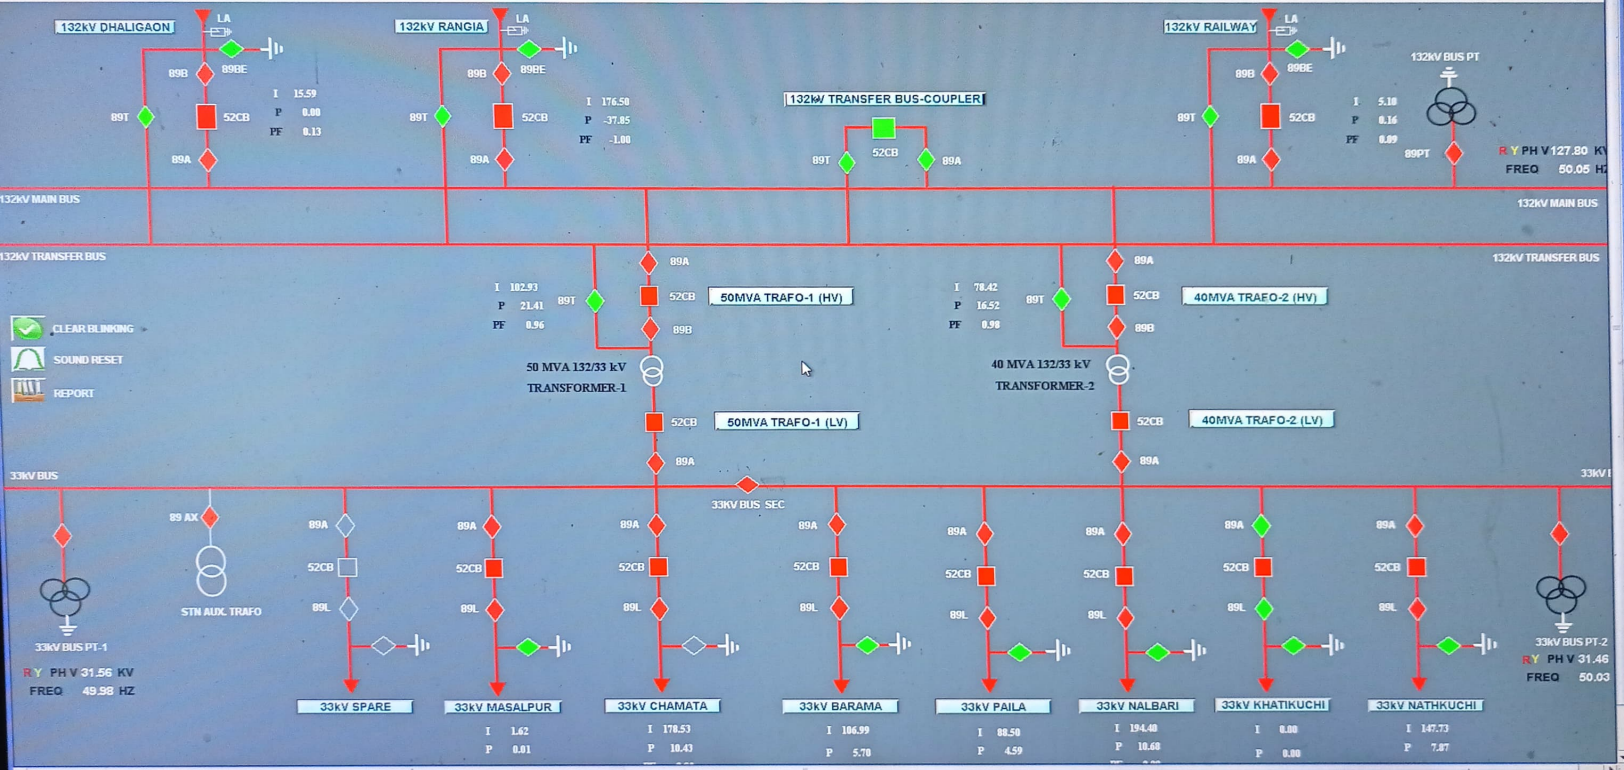

132kV DHALIGAON

I 15.59
P 0.00
PF 0.13

132kV RANGIA

I 176.50
P -37.85
PF -1.00

132kV RAILWAY

I 5.18
P 0.16
PF 0.89

132kV TRANSFER BUS-COUPLER

132kV MAIN BUS

132kV MAIN BUS

132kV TRANSFER BUS

132kV TRANSFER BUS

- CLEAR BLINKING
- SOUND RESET
- REPORT

I 182.93
P 21.41
PF 0.96

50MVA TRAF0-1 (HV)

50 MVA 132/33 kV TRANSFORMER-1

I 78.42
P 16.52
PF 0.98

40MVA TRAF0-2 (HV)

40 MVA 132/33 kV TRANSFORMER-2

50MVA TRAF0-1 (LV)

40MVA TRAF0-2 (LV)

33kV BUS

33kV BUS

33kV BUS PT-1

R Y PH V 31.56 KV
FREQ 49.98 HZ

33kV BUS PT-2

R Y PH V 31.46
FREQ 50.03

33kV SPARE

33kV MASALPUR

I 1.62
P 0.01

33kV CHAMATA

I 178.53
P 10.43

33kV BARAMA

I 106.99
P 5.70

33kV PAILA

I 88.50
P 4.59

33kV NALBARI

I 194.40
P 10.68

33kV KHATIKUCHI

I 0.00
P 0.00

33kV NATHKUCHI

I 147.73
P 7.87